


PFAS RESULTS



MassDEP MCL
20.00 ng/L

WRWS Average
4.34 ng/L

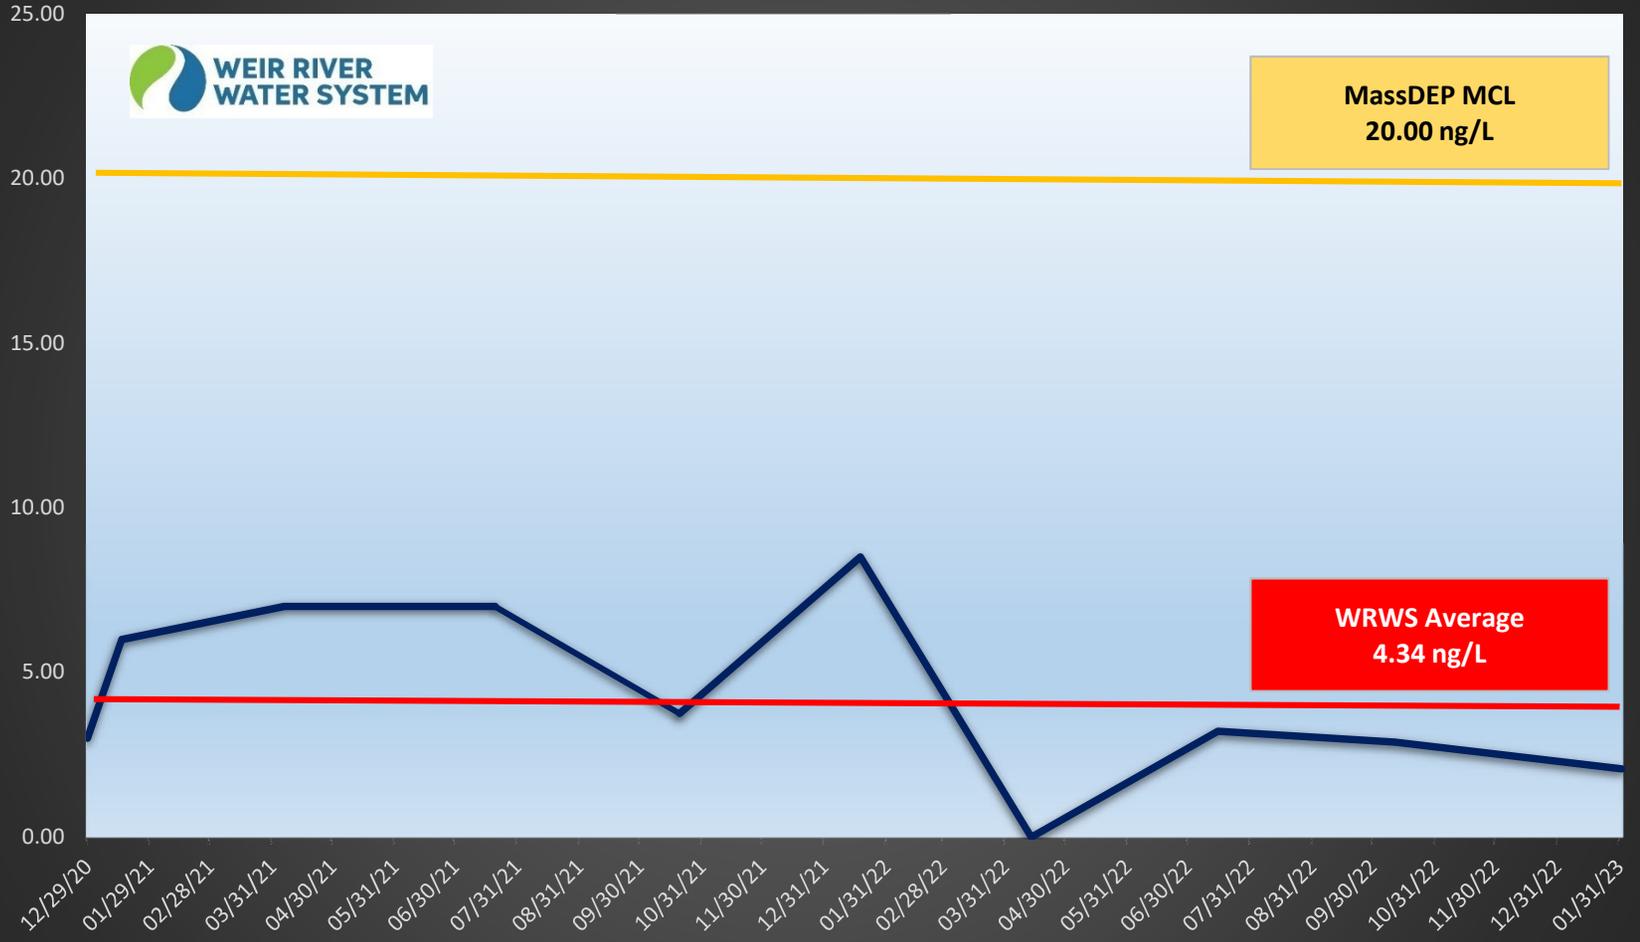

	12/29/20	01/15/21	04/06/21	07/20/21	10/20/21	01/18/22	04/13/22	07/15/22	10/11/22	02/01/23
Series1	3.00	6.00	7.00	7.00	3.75	8.51	0.00	3.21	2.88	2.07